


REVISIONS					
ECN	ZONE	REV.	DESCRIPTION	DATE	APPROVED
		A	ADD SOLID STATE SWITCH MODULE	9/15/98	W. ROSE
		B	DEL P4-8, ADD J1-2 TO J2-5	5/21/99	W. ROSE
946		C	1. USE RING LUGS ON VOLTAGE INTERFACE TB1 AND TB2 USE RING LUGS ON VOLTAGE 2. PUT 115 VAC ON CONTACTOR TERMINAL #2, RTN ON #1	4/10/00	W. ROSE
949		D	1. REPLACED TB1 AND TB2 WITH STRAIN RELIEFS AND WIRE 2. ADDED WIRE NUMBERS FOR VOLTAGE INTERFACE WIRES.	5-19-00	RWY

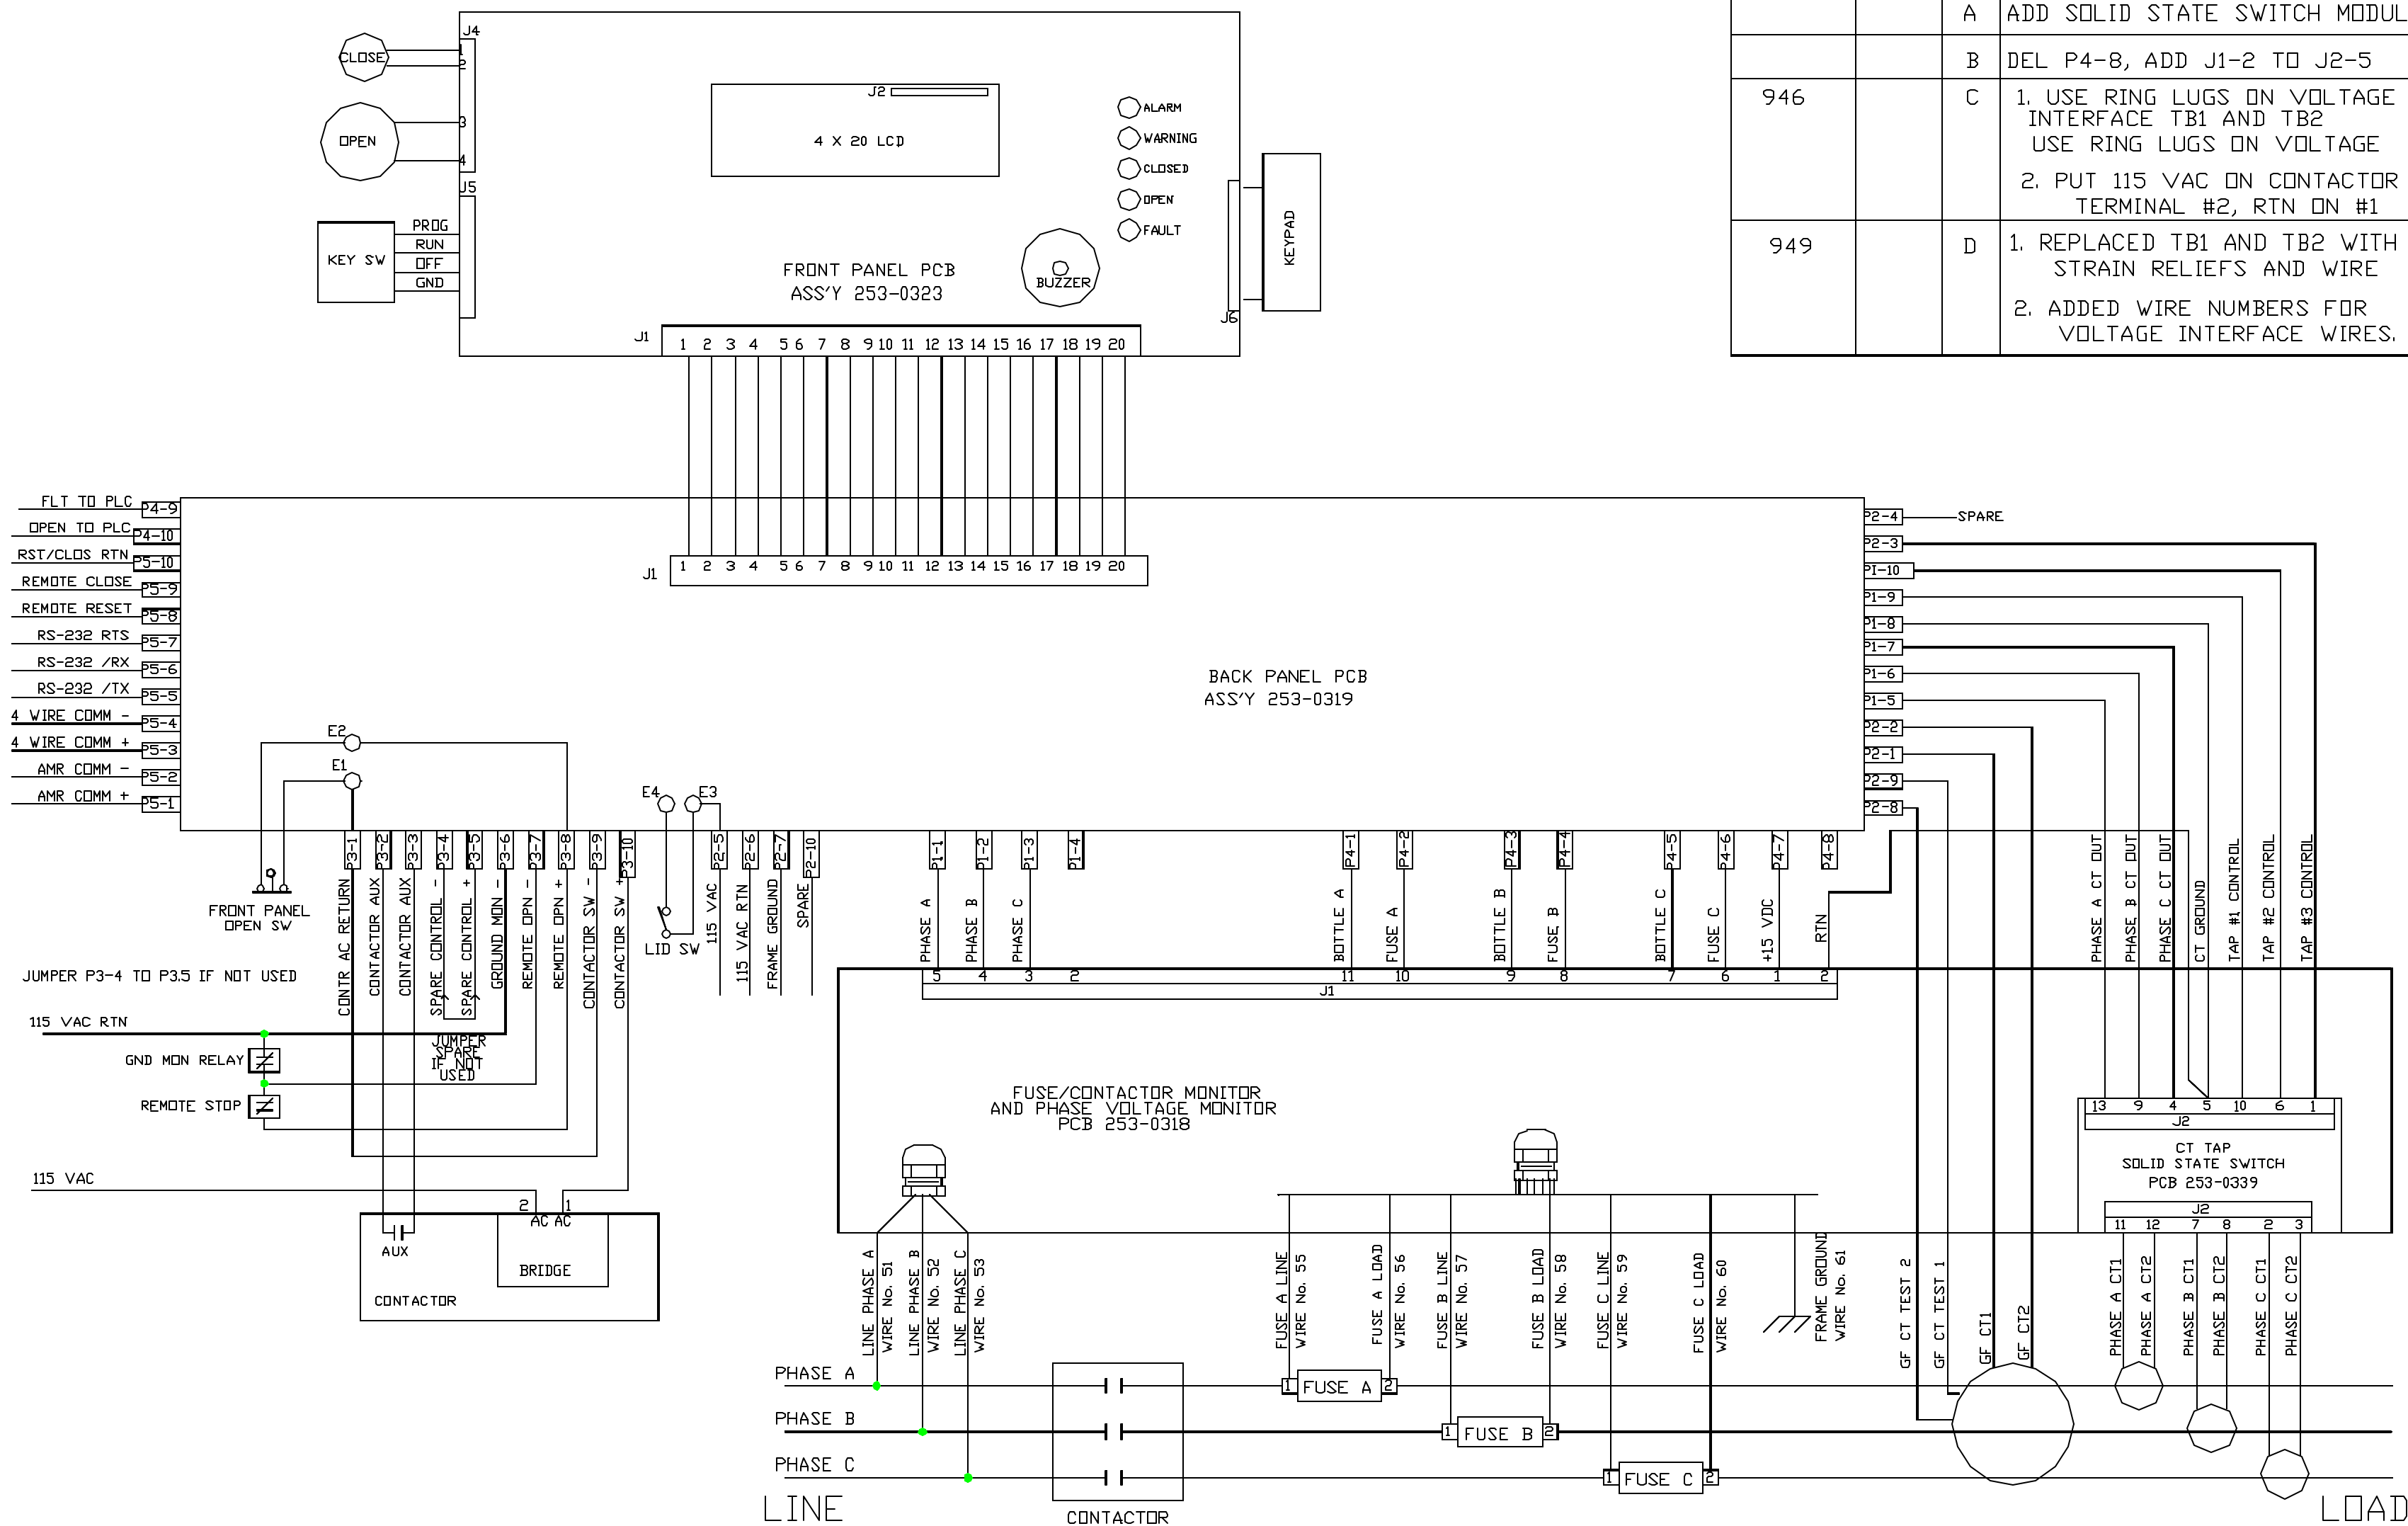

NOT TO BE CHANGED WITHOUT APPROVAL OF MSHA

ASSEMBLY NO.	PROPRIETARY	AMERICAN MINE RESEARCH PO BOX 234 ROCKY GAP, VA. 24366		
CHECKED BY: _____	THIS DRAWING DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO AND IS THE PROPERTY OF THE AND MAY NOT BE USED, REPRODUCED OR DISCLOSED IN ANY MANNER WITHOUT THE EXPRESSED WRITTEN CONSENT FROM:	TITLE: CB-PRO INTERCONNECT SCHEMATIC		
DATE: _____		SIZE: C	DRAWN: W.ROSE	DRAWING NUMBER: 218-0236B
APPROVED: _____	NEXT HIGHER ASSEMBLY:	ENGR: W.ROSE	REV.:	D
DATE: _____		SCALE:	DATE: 08-10-00	SHEET 1 OF 1
TOLERANCES: X.X ~ 0.050" X.XX ~ 0.010" X.XXX ~ 0.005" ANGLES ~ 0.500° UNLESS OTHERWISE NOTED				